

# HS-420IT Intrinsically Safe Accelerometer


4-20mA velocity and temperature output via PUR Cable

## Key Features



- Intrinsically Safe with European, USA, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Temperature output

## Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

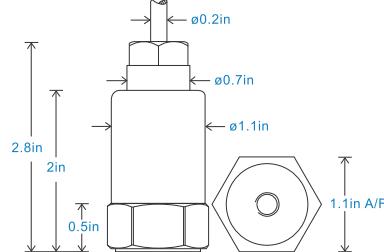

## Connection Details

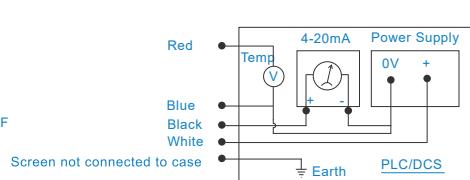

## Technical Performance

Mounted Base Resonance	5kHz min
Velocity Ranges	see: 'How To Order' table $\pm 10\%$
Frequency Response	Nominal 80Hz at 72°F
Isolation	Base isolated
Range	50g peak
Temperature Output	10mV/°C - 0-1V proportional to 32-212°F (to convert this to 4-20mA use the HS-540 module)
Transverse Sensitivity	Less than 5%

## Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	5.9ft. lbs
Weight	5.2 oz. (nominal)
Maximum Cable Length	3,280 ft.
Standard Cable Length	16 ft.
Screened Cable	PUR - length to be specified with order
Mounting Threads	see: 'How To Order' table
Submersible Depth	100 metres max (10 bar)


## Electrical

Current Output	4-20mA DC proportional to Velocity Range
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	>10 <sup>8</sup> Ohms at 500 Volts

## Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP68
Maximum Shock	5000g
EMC	EN61326-1:2013


## Typical Frequency Response

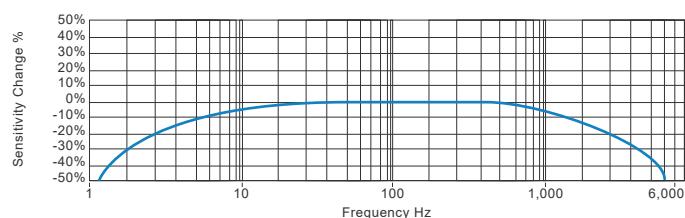

## Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



## Certifications



This product is certified in accordance with  
UL 913, 8th Ed. Rev. December 6, 2013  
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



[www.hansfordsensors.com](http://www.hansfordsensors.com)  
[sales@hansfordsensors.com](mailto:sales@hansfordsensors.com)

We reserve the right to alter the specification of this product without prior notice

TS1113U.9




# HS-420IT Intrinsically Safe Accelerometer

4-20mA velocity and temperature output via PUR Cable


## Intrinsically Safe Requirements

Maximum Cable Length	nominal 100 metres see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231 Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C
Certificate details: Group II	IECEx BAS08.0034X Baseefa08ATEX0086X Ex ia IIC T6 Ga Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	② II 1GD Barrier	1 x Pepperl + Fuchs Galvanic Isolator KFD2-VR-Ex1.18 (BAS01ATEX7262) see attached system drawings
		② II 1GD Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	1 x MTL Zener Barrier MTL7764+ac (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z764 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
		System Connections for Galvanic Isolator	see attached system drawings
Terminal Parameters	Ui = 44V, Ii = 117mA, Pi = 0.722W Group II	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
500V Isolation	Units Will Pass A 500V Isolation Test		
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust)	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

## How To Order

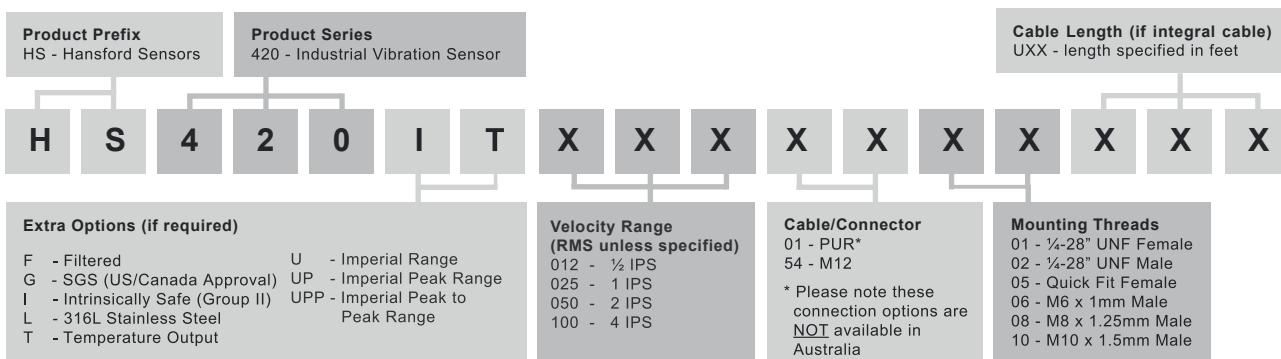

## Non-Hazardous Area

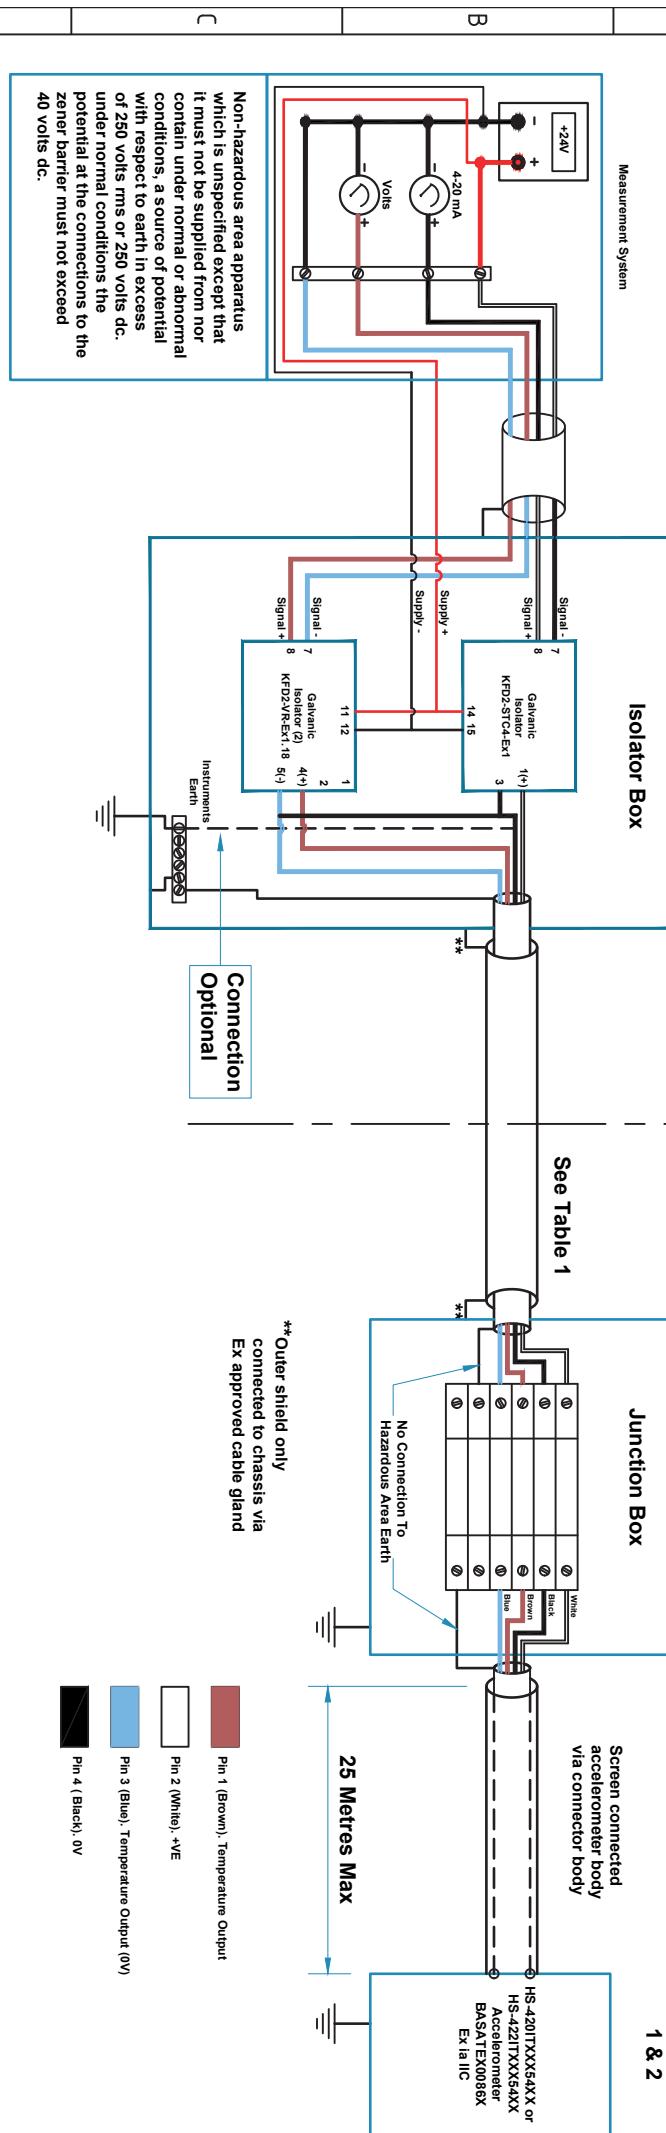

**Table 1: Cable Connecting The Connector Version**

Table 1: Cable Connecting The Connector Version		
Group	Capacitance $\mu\text{F}$	L/R Ratio $\mu\text{H}/\Omega$
II C	0.024	47
II B	0.247	71
II A	0.767	429

Hansford Sensors Ltd

Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

## Accelerometer System

Digitized by srujanika@gmail.com

HS-420IT & HS-422IT

Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio ( $L/R$ ) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. The installer is to perform a risk assessment in accordance with clause 6.2.2 of EN 60079-11.

## Non-Hazardous Area


## Hazardous Area

See Note  
1 & 2

## Barrier Box

## Junction Box

Measurement System

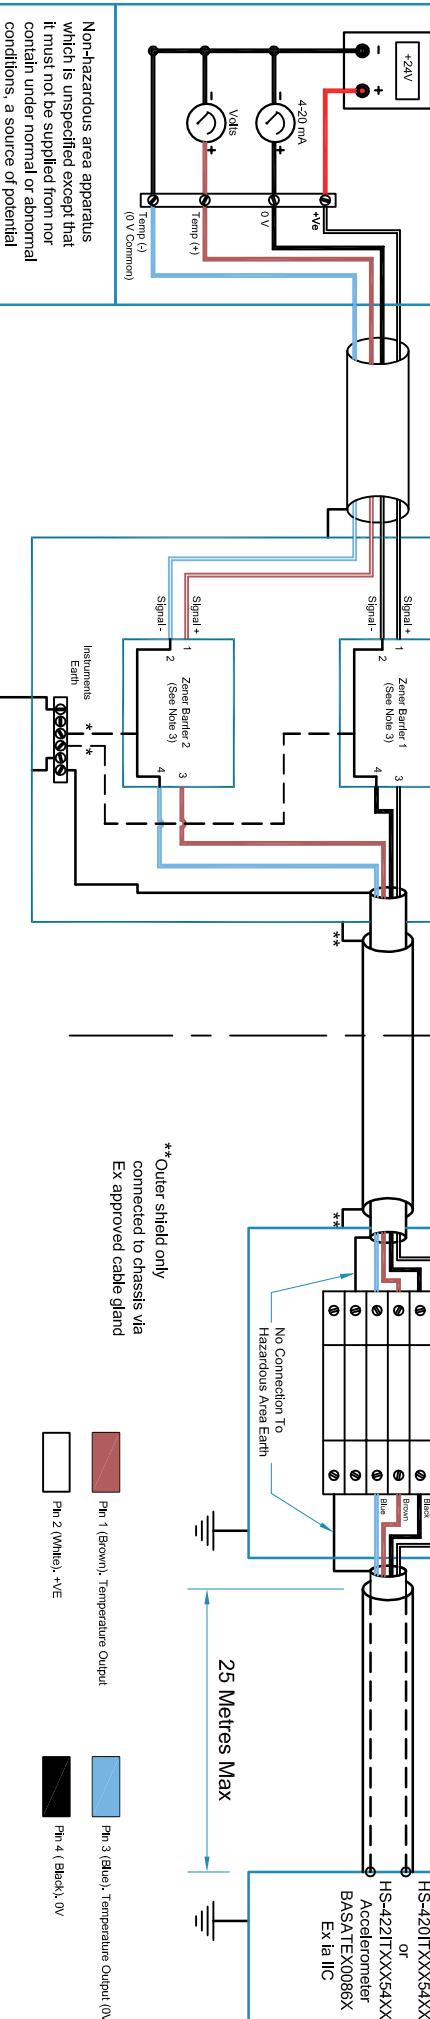Screen connected  
accelerometer body  
via connector body  
HS-4201TXXX54XX  
or  
HS-421TXXX54XX  
Accelerometer  
BASA/TEX0086X  
Ex ia IIC

\*Optional Connection  
if Chassis Plate is Not Grounded

Non-hazardous area apparatus  
which is unspecified except that  
it must not be supplied from nor  
contain under normal or abnormal  
conditions, a source of potential  
with respect to earth, in excess  
of 250 volts rms or 250 volts dc.  
Under normal conditions the  
potential at the connections to the  
zener barrier must not exceed  
400 volts dc.

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere
3. Zener diode safety barrier (1) certified by an ec approved body to [IEEx ia] IIC having the following output parameters:  $U_0 = 28V$  dc,  $I_0 = 93mA$  dc,  $P_{0.65W}$ , e.g. MTL7787+ to BAS01ATEX7217 or Pepperl + Fuchs Z787 to BAS01ATEX7005
4. Zener diode safety barrier (2) certified by an ec approved body to [IEEx ia] IIC having the following output parameters:  $U_0 = 12V$  dc,  $I_0 = 12mA$  dc,  $P_0 = 0.036W$ , MTL7764+ac to BAS01ATEX7217 or Pepperl + Fuchs Z764 to BAS01ATEX7005.
5. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-22 and install lightning protection arrestors as deemed necessary.

Table 1: Cable Connecting The Connector Version

Group	Capacitance $\mu F$	L/R Ratio $\mu H/\Omega$
II C	0.080	17.9
II B	0.246	60
II A	0.661	161

## Hansford Sensors Ltd

HS-4201T & HS-4221T  
Accelerometer System

Ex ia IIIC T6 (-40°C ≤ Ta ≤ +60°C)



10 of EN 60079-22 and install lightning protection arrestors as deemed necessary.

E

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	Group	Capacitance $\mu F$	L/R Ratio $\mu H/\Omega$
A	Release	16/04/15	MJS	CMH				
					Tolerances Unless Stated			
					0 or 0.0 ±0.5 1/2 Finish All Over			
F					0.00 ±0.15			
					Angle ±5°			
					Threads 96 H6			
					Hansford Sensors Ltd Artisan, Hillbottom Rd Sands Industrial Estate High Wycombe Bucks HP12 4HJ			
1		2		3	4		5	6
							7	8

D

E

F