

# HS-422I/M Intrinsically Safe Accelerometer


4-20mA acceleration output via Flame Retardant Cable

## Key Features


- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Low smoke, halogen free cable

## Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

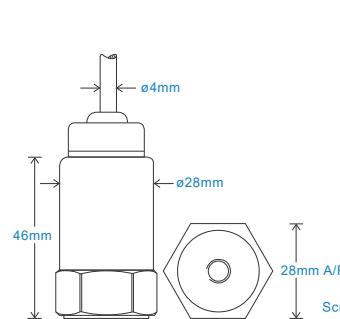

### Connection Details

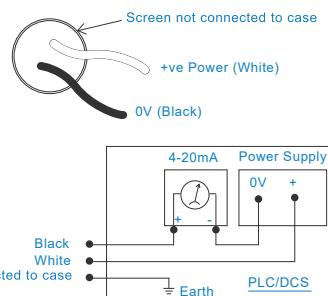


## Technical Performance

Technical Performance		Mechanical	
Mounted Base Resonance	10kHz min	Case Material	Stainless Steel
Acceleration Ranges	see: 'How To Order' table ±10%	Sensing Element/Construction	PZT/Compression
	Nominal 80Hz at 22°C	Mounting Torque	8Nm
Frequency Response	10Hz (600cpm) to 5kHz (300kcpm) ± 5% - ISO10816	Weight	150gms (nominal) 1000 metres
Isolation	Base isolated	Maximum Cable Length	5 metres
Range	50g peak	Standard Cable Length	Flame Retardant - length to be specified with order
Transverse Sensitivity	Less than 5%	Mounting Threads	see: 'How To Order' table

## Electrical

Current Output	4-20mA DC proportional to acceleration	Operating Temperature Range	see: attached certification details
Supply Voltage	15-30 Volts DC (for 4-20mA)	Sealing	IP65
Settling Time	2 seconds	Maximum Shock	5000g
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts	EMC	EN61326-1:2013
Case Isolation	>10 <sup>8</sup> Ohms at 500 Volts		

## Typical Frequency Response

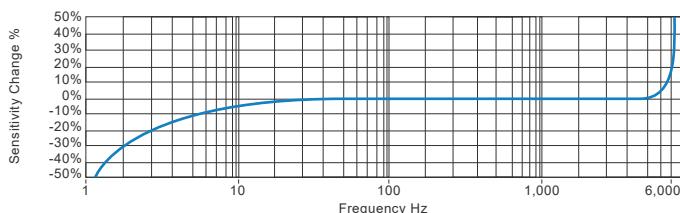


## Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP65
Maximum Shock	5000g
EMC	EN61326-1:2013

## Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



## Certifications



This product is certified in accordance with  
UL 913, 8th Ed. Rev. December 6, 2013  
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



[www.hansfordsensors.com](http://www.hansfordsensors.com)  
[sales@hansfordsensors.com](mailto:sales@hansfordsensors.com)

We reserve the right to alter the specification of this product without prior notice

TS0619




# HS-422I/M Intrinsically Safe Accelerometer

4-20mA acceleration output via Flame Retardant Cable

## Intrinsically Safe Requirements


Maximum Cable Length	nominal 100 metres see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231
Certificate details: Group I + II	IECEx BAS08.0034X Baseefa08ATEX0086X	Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C	
	Ex ia IIC T6 Ga Ex ia IIIC T80°C IP65 Da Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	② II 1GD ② I M1 ② I Ma	Barrier 1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings
Certificate details: Group II	Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	② II 1GD	1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I	System Connections for Galvanic Isolator	see attached system drawings
500V Isolation	Units Will Pass A 500V Isolation Test	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Australia Approval Group 1	IECEx ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

## How To Order

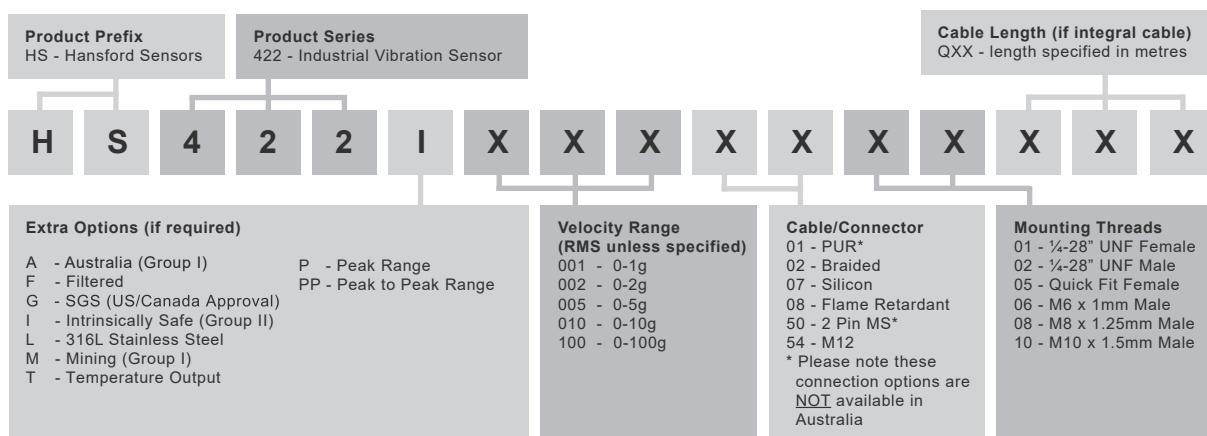

## Non-Hazardous Area

## Hazardous Area

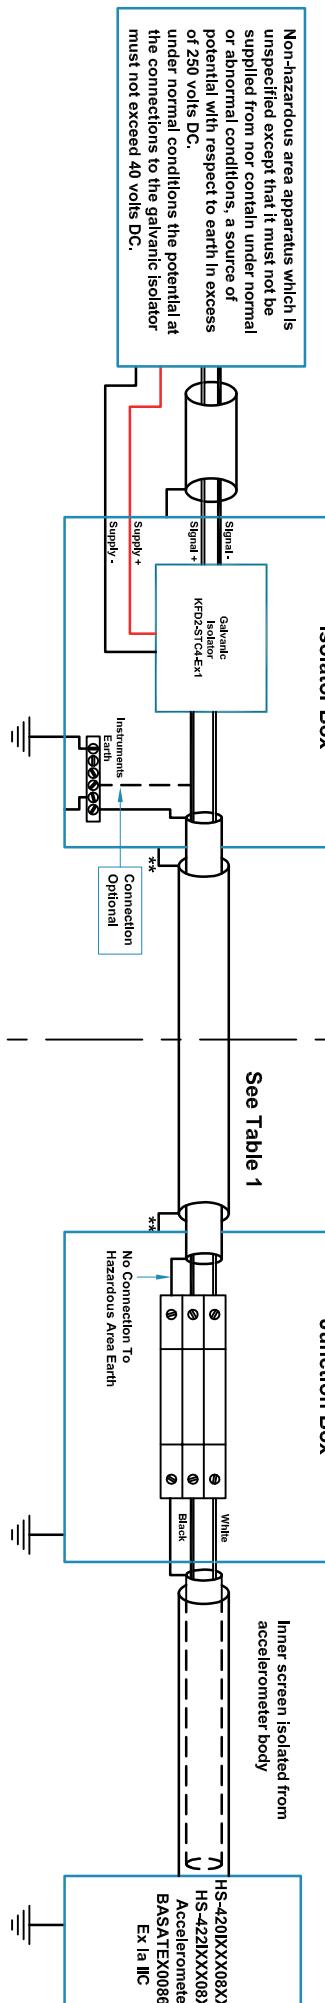See Note  
1 & 2

\*\* Outer shield only connected to chassis via  
Ex approved cable gland

**Table 1: Cable Parameters For Additional Cable Lengths**

**Accelerometer With Integral Cable Length  $\leq$  10m**

Group	Capacitance $\mu$ F	L/R Ratio $\mu$ H/ $\Omega$
IIC	0.097	72
IIB	0.768	277
IIA	2.598	585

**Hansford Sensors Ltd**

HS-420I & HS-422I  
Accelerometer System

Ex ia IIC T6 (-40°C  $\leq$  Ta  $\leq$  +60°C)

**Notes:**

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A
A	Release	17/06/10	MJS	CMH	

**Tolerances Unless Stated**

0 or 0.0  $\pm$ 0.5  $\frac{1}{16}$  Finish All Over  
0.00  $\pm$ 0.15 Threads g6 H6  
Angle  $\pm$ 5°



Hansford Sensors Ltd  
Saunderton Business Park  
Haw Lane  
Saunderton  
Bucks HP14 4JE

F	Rev No	Date Drg	Drg By	Appd By	Material: N/A
F					

E	Rev No	Date Drg	Drg By	Appd By	Material: N/A
E					

D	Rev No	Date Drg	Drg By	Appd By	Material: N/A
D					


C	Rev No	Date Drg	Drg By	Appd By	Material: N/A
C					

B	Rev No	Date Drg	Drg By	Appd By	Material: N/A
B					

A	Rev No	Date Drg	Drg By	Appd By	Material: N/A
A					

## Non-Hazardous Area

## Hazardous Area

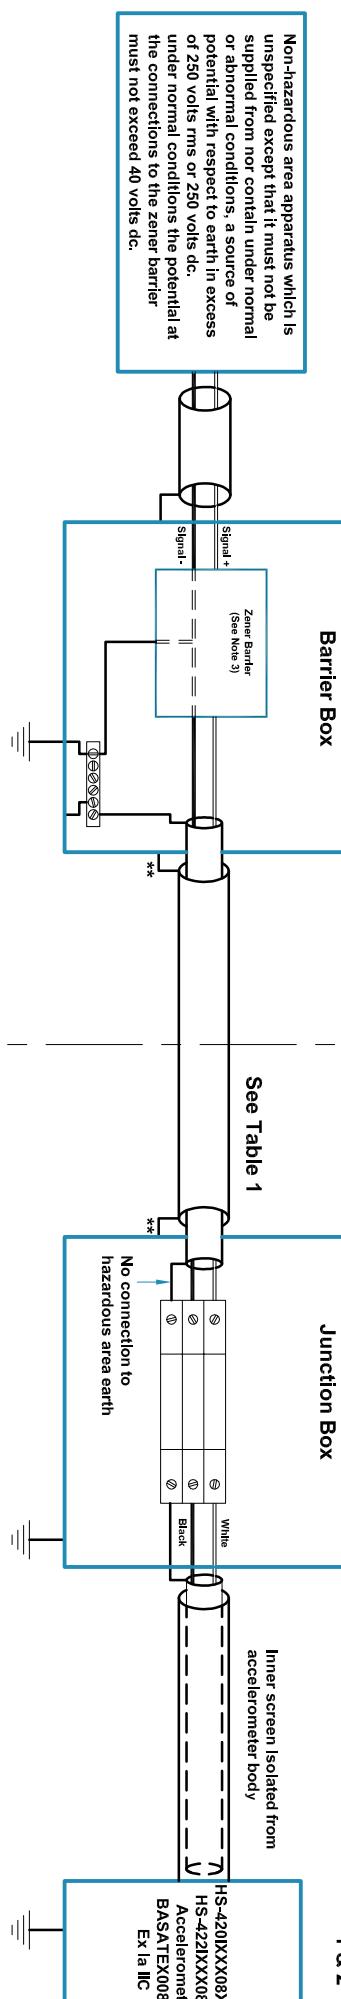See Note  
1 & 2

\*\* Outer shield only connected to chassis via Ex approved cable gland

No connection to hazardous area earth

Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length  $\leq$  10m

Group	Capacitance $\mu$ F	L/R Ratio $\mu$ H/ $\Omega$
IIC	0.081	56
IIB	0.247	168
IIA	0.662	448

Accelerometer With Integral Cable Length  $\leq$  50m

Group	Capacitance $\mu$ F	L/R Ratio $\mu$ H/ $\Omega$
IIC	0.075	56
IIB	0.241	168
IIA	0.656	448

Accelerometer With Integral Cable Length  $\leq$  100m

Group	Capacitance $\mu$ F	L/R Ratio $\mu$ H/ $\Omega$
IIC	0.067	56
IIB	0.233	168

Group	Capacitance $\mu$ F	L/R Ratio $\mu$ H/ $\Omega$
IIA	0.648	448

**Baseefa**  
Certification  
Schedule  
Drawing

*S. M. Jackson*

baseefa 08 Y 0087

## Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. Any shunt zener diode safety barrier certified by an EC approved body to [IEEx ia] IIC having the following output parameters:  $U_o = 28V$  dc,  $I_o = 93mA$  dc,  $P_o = 0.65W$ , e.g. MTL7787 to BASATEXZ217 or Pepperl + Fuchs Z787 to BASATEX7005.
4. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A			Description: System Connections For HS-420 & HS-422I Group II Accelerometers With Non-Armoured FR Polyurethane Cable F.U.W. Zener Barrier	
A	Release	10/03/08	MJS	CMH	Tolerances Unless Stated 0 or 0.0 $\pm 0.5$ $\frac{1}{16}$ Finish All Over 0.00 $\pm 0.15$ Threads g6 H6 Angle $\pm 5^\circ$ Saunderton Haw Lane Saunderton Bucks HP14 4JE	 Hansford Sensors Ltd Excellence in Vibration Monitoring Saunderton Business Park		Do Not Scale	All Dimensions In mm Unless Otherwise Stated
B						<p><b>If In Doubt - Ask!</b></p> <p>Scale: NTS</p> <p>Form Number: QF024 Issue 1</p> <p>Sheet: 2 of 2</p>			
C	1	2	3	4	5	6	7	8	