

HS-422I/M Intrinsically Safe Accelerometer



4-20mA acceleration output via Braided Cable

Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Customisable features

Industries

Building services, Pulp and Paper,
Mining, Metals, Utilities, Automotive,
Water, Pharmaceutical

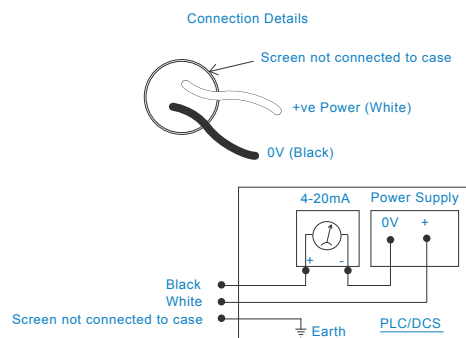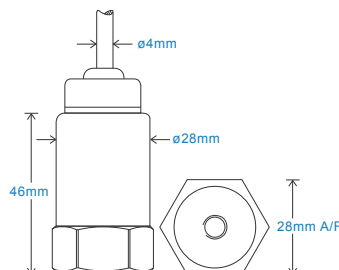

Technical Performance

Mounted Base Resonance	10kHz min
Acceleration Ranges	see: 'How To Order' table $\pm 10\%$ Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 5kHz (300kcpm) $\pm 5\%$ - ISO10816
Isolation	Base isolated
Range	50g peak
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
Maximum Cable Length	1000 metres
Standard Cable Length	5 metres
Screened Cable	Braided - length to be specified with order
Mounting Threads	see: 'How To Order' table


Electrical

Current Output	4-20mA DC proportional to acceleration
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	$>10^8$ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP65
Maximum Shock	5000g
EMC	EN61326-1:2013


Typical Frequency Response

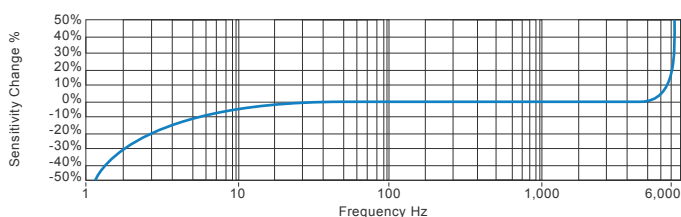

Applications

Fans, Motors, Pumps, Compressors,
Centrifuges, Conveyors, Air Handlers,
Gearboxes, Rolls, Dryers, Presses,
Cooling, VAC, Spindles, Machine Tooling,
Process Equipment

Vibration sensor should be firmly fixed to a flat surface
(spot face surface may be needed to be produced and
cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
TS065.21




4-20mA acceleration output via Braided Cable

Intrinsically Safe Requirements

Maximum Cable Length		nominal 100 metres see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231
			Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C	
Certificate details: Group I + II		IECEX BAS08.0034X Baseefa08ATEX0086X	Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C	
		Ⓜ II 1GD	Barrier	1 x Pepperl + Fuchs Galvanic Isolator
		Ex ia IIC T6 Ga		KFD2-STC4-Ex1, which has superseded
		Ex ia IIIC T80°C IP65 Da		KFD2-CR-Ex1.30300 (BAS00ATEX7164)
		Ⓜ I M1		see attached system drawings
		Ex ia I Ma		
		(-40°C ≤ Ta ≤ +60°C)		1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217)
Certificate details: Group II		Ⓜ II 1GD		or Pepperl + Fuchs Zener Barrier
		Ex ia IIC T4 Ga		Z787 (BAS01ATEX7005) or any other barrier that
		Ex ia IIIC T130°C IP65 Da		conforms to system drawings attached
		(-40°C ≤ Ta ≤ +110°C)		
			System Connections for Zener Barrier	see attached system drawings
Accelerometer System Certificate		Baseefa08Y0087		
		Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)	System Connections for Galvanic Isolator	see attached system drawings
		*On request - consult Sales Office		
			Terminal Parameters	Ui = Vmax = 28V
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II			Ii = Imax = 115mA
	Ui = 16.5V Pi = 0.65W			Pi = 0.65W
	or Ui = 28V Ii = 115mA Pi = 0.65W Group I			
			Notes:	Special conditions of safe use for Group II dust.
500V Isolation	Units Will Pass A 500V Isolation Test			The free end of the cable on the integral cable
				version of the apparatus must be terminated in
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas)			an appropriately certified dust-proof enclosure.
	Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas)			The unit has no serviceable parts.
	Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust)			
	Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust)			
	Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)			
Australia Approval Group 1		IECEX ITA 10.0003X		
		Ex ia I Ma		
		(-40°C ≤ Ta ≤ +60°C)		
South African Approval		Certificate No. MASC MS/16-0229X		
		Group I and II (As Baseefa/ATEX)		

How To Order

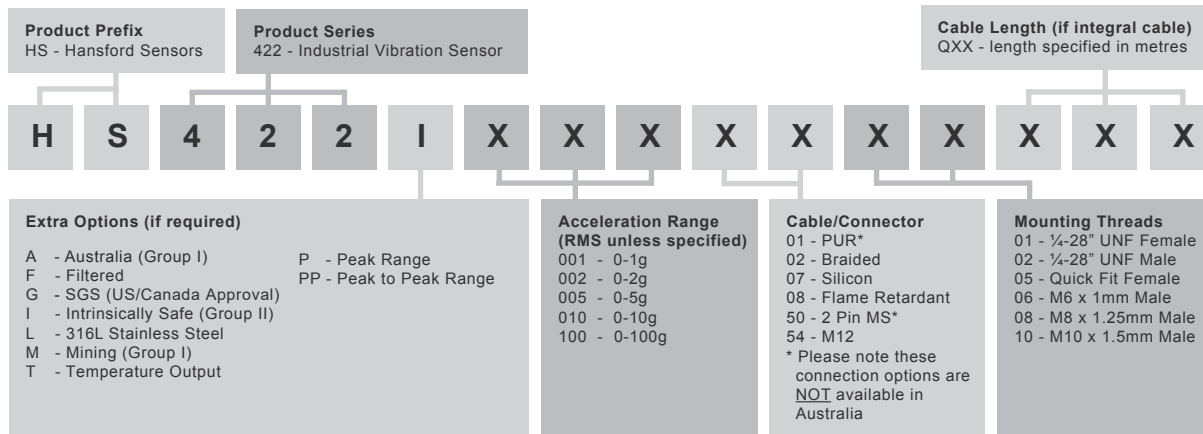

www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice



