

# HS-422I/M Intrinsically Safe Accelerometer



4-20mA acceleration output via PUR Cable

## Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Waterproof and resistant to oil

## Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

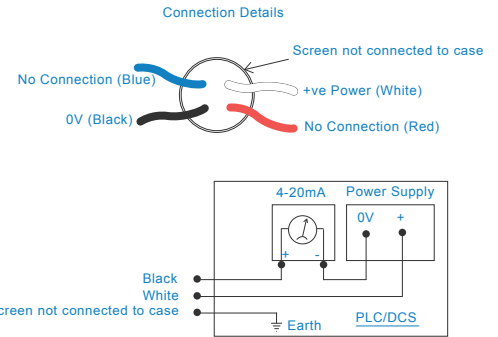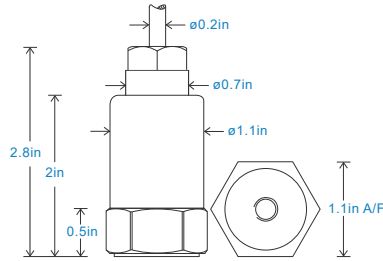

## Technical Performance

|                        |   |
|------------------------|---|
| Mounted Base Resonance | 10kHz min                                 |
| Acceleration Ranges    | see: 'How To Order' table $\pm 10\%$      |
|                        | Nominal 80Hz at 72°F                      |
| Frequency Response     | 600cpm (10Hz) to 300kcpm (5kHz) $\pm 5\%$ |
|                        | - ISO10816                                |
| Isolation              | Base isolated                             |
| Range                  | see: 'How To Order' table                 |
| Transverse Sensitivity | Less than 5%                              |

## Mechanical

|                              |   |
|------------------------------|---|
| Case Material                | Stainless Steel                         |
| Sensing Element/Construction | PZT/Compression                         |
| Mounting Torque              | 5.9ft. lbs                              |
| Weight                       | 5.2 oz. (nominal)                       |
| Maximum Cable Length         | 3,280 ft.                               |
| Standard Cable Length        | 16 ft.                                  |
| Shielded Cable               | PUR - length to be specified with order |
| Mounting Threads             | see: 'How To Order' table               |
| Submersible Depth            | 328 ft. max. (10 bar)                   |


## Electrical

|                  |   |
|------------------|---|
| Current Output   | 4-20mA DC proportional to acceleration    |
| Supply Voltage   | 15-30 Volts DC (for 4-20mA)               |
| Settling Time    | 2 seconds                                 |
| Output Impedance | Loop Resistance 600 Ohms max. at 24 Volts |
| Case Isolation   | >10 <sup>8</sup> Ohms at 500 Volts        |

## Environmental

|                             |                                     |
|-----------------------------|-------------------------------------|
| Operating Temperature Range | see: attached certification details |
| Sealing                     | IP68                                |
| Maximum Shock               | 5000g                               |
| EMC                         | EN61326-1:2013                      |


## Typical Frequency Response

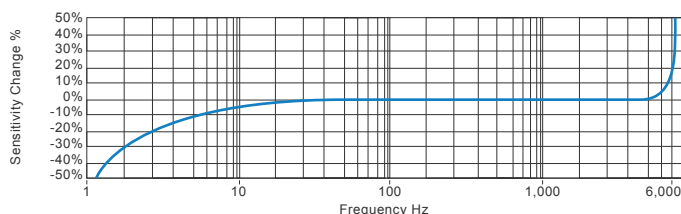

## Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



## Certifications



This product is certified in accordance with  
**UL 913, 8th Ed. Rev. December 6, 2013**  
**CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2**



[www.hansfordsensors.com](http://www.hansfordsensors.com)  
[sales@hansfordsensors.com](mailto:sales@hansfordsensors.com)

We reserve the right to alter the specification of this product without prior notice  
 TS435U.13



## 4-20mA acceleration output via PUR Cable

## Intrinsically Safe Requirements

|  |  |  |  |  |
|--|--|--|--|--|
| <b>Maximum Cable Length</b>              |  | nominal 100 metres<br>see attached system drawings   | <b>US/Canada Approvals</b>   | Certificate No. SGSNA/18/SUW/0000231   |
|  |  |  | Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C,<br>Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C  |  |
| <b>Certificate details:</b> Group I + II |  | IECEX BAS08.0034X<br>Baseefa08ATEX0086X  | Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C  |  |
|  |  | ⓂII 1GD<br>Ex ia IIC T6 Ga<br>Ex ia IIIC T80°C IP65 Da   | <b>Barrier</b>   | 1 x Pepperl + Fuchs Galvanic Isolator<br>KFD2-STC4-Ex1, which has superseded<br>KFD2-CR-Ex1.30300 (BAS00ATEX7164)  |
|  |  | ⓂI M1<br>Ex ia I Ma<br>(-40°C ≤ Ta ≤ +60°C)  | see attached system drawings   |  |
| <b>Certificate details:</b> Group II     |  | ⓂII 1GD<br>Ex ia IIC T4 Ga<br>Ex ia IIIC T130°C IP65 Da<br>(-40°C ≤ Ta ≤ +110°C)                 | 1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217)<br>or Pepperl + Fuchs Zener Barrier<br>Z787 (BAS01ATEX7005) or any other barrier that<br>conforms to system drawings attached |  |
|  |  |  | <b>System Connections for Zener Barrier</b>  | see attached system drawings   |
| <b>Accelerometer System Certificate</b>  |  | Baseefa08Y0087<br>Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)<br><i>*On request - consult Sales Office</i> | <b>System Connections for Galvanic Isolator</b>  | see attached system drawings   |
|  |  |  | <b>Terminal Parameters</b>   | Ui = Vmax = 28V<br>Ii = Imax = 115mA<br>Pi = 0.65W   |
| <b>Terminal Parameters</b>               | Ui = 28V, Ii = 115mA, Pi = 0.65W   Group II<br>Ui = 16.5V Pi = 0.65W<br>or Ui = 28V Ii = 115mA Pi = 0.65W   Group I  |  | <b>Notes:</b>  | Special conditions of safe use for Group II dust.<br>The free end of the cable on the integral cable<br>version of the apparatus must be terminated in<br>an appropriately certified dust-proof enclosure. |
| <b>500V Isolation</b>                    | Units Will Pass A 500V Isolation Test  |  | The unit has no serviceable parts.   |  |
| <b>Certified Temperature Range</b>       | Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas)<br>Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas)<br>Ex ia IIIC T80°C IP65 Da ( -40°C ≤ Ta ≤ +60°C) (Dust)<br>Ex ia IIIC T130°C IP65 Da ( -40°C ≤ Ta ≤ +110°C) (Dust)<br>Ex ia I Ma ( -40°C ≤ Ta ≤ +60°C) (Mining) |  |  |  |
| <b>Australia Approval Group 1</b>        |  | IECEX ITA 10.0003X<br>Ex ia I Ma<br>(-40°C ≤ Ta ≤ +60°C)   |  |  |
| <b>South African Approval</b>            |  | Certificate No. MASO MS/16-0229X<br>Group I and II (As Baseefa/ATEX)                             |  |  |

## How To Order

