


Installation Dimensional Drawing for HS-100S Series 2 Core Overbraided ETFE Cable

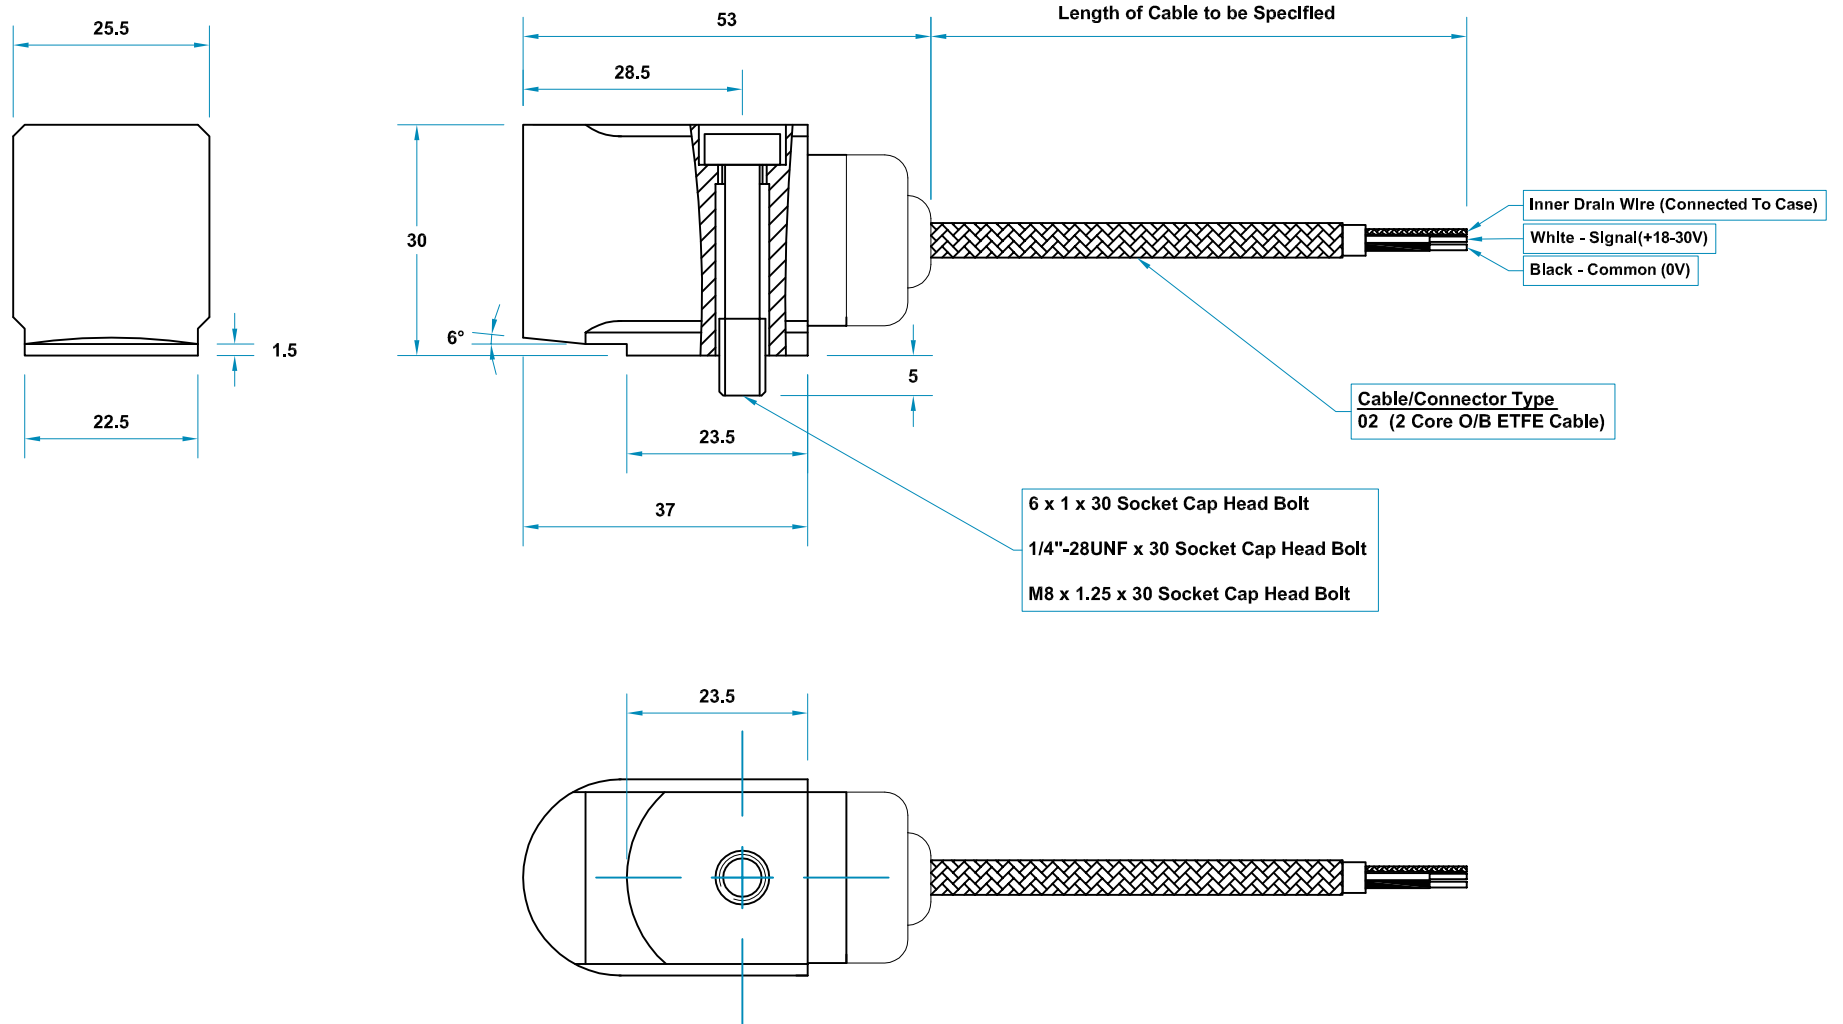

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: <i>N/A</i>	 Hansford Sensors <i>Excellence in Vibration Monitoring</i> Hansford Sensors Ltd Artisan Hillbottom Road Sands Industrial Estate High Wycombe Bucks HP12 4HJ		Description: Installation Dimensional Drawing for HS-100S Series 2 Core Overbraided ETFE Cable	
A	Release	20/06/11	MJS	CMH	Tolerances Unless Stated 0 or 0.0 ±0.5 0.00 ±0.15 Angle ±5°		All Dimensions In mm Unless Otherwise Stated	Drawing No: CD034-3-C	
C	DRF0250	11/09/12	MJS	CMH				Finish All Over ∇ 1.6/ Threads g6 H6	If In Doubt - Ask!
							Sheet: 1 of 1		